


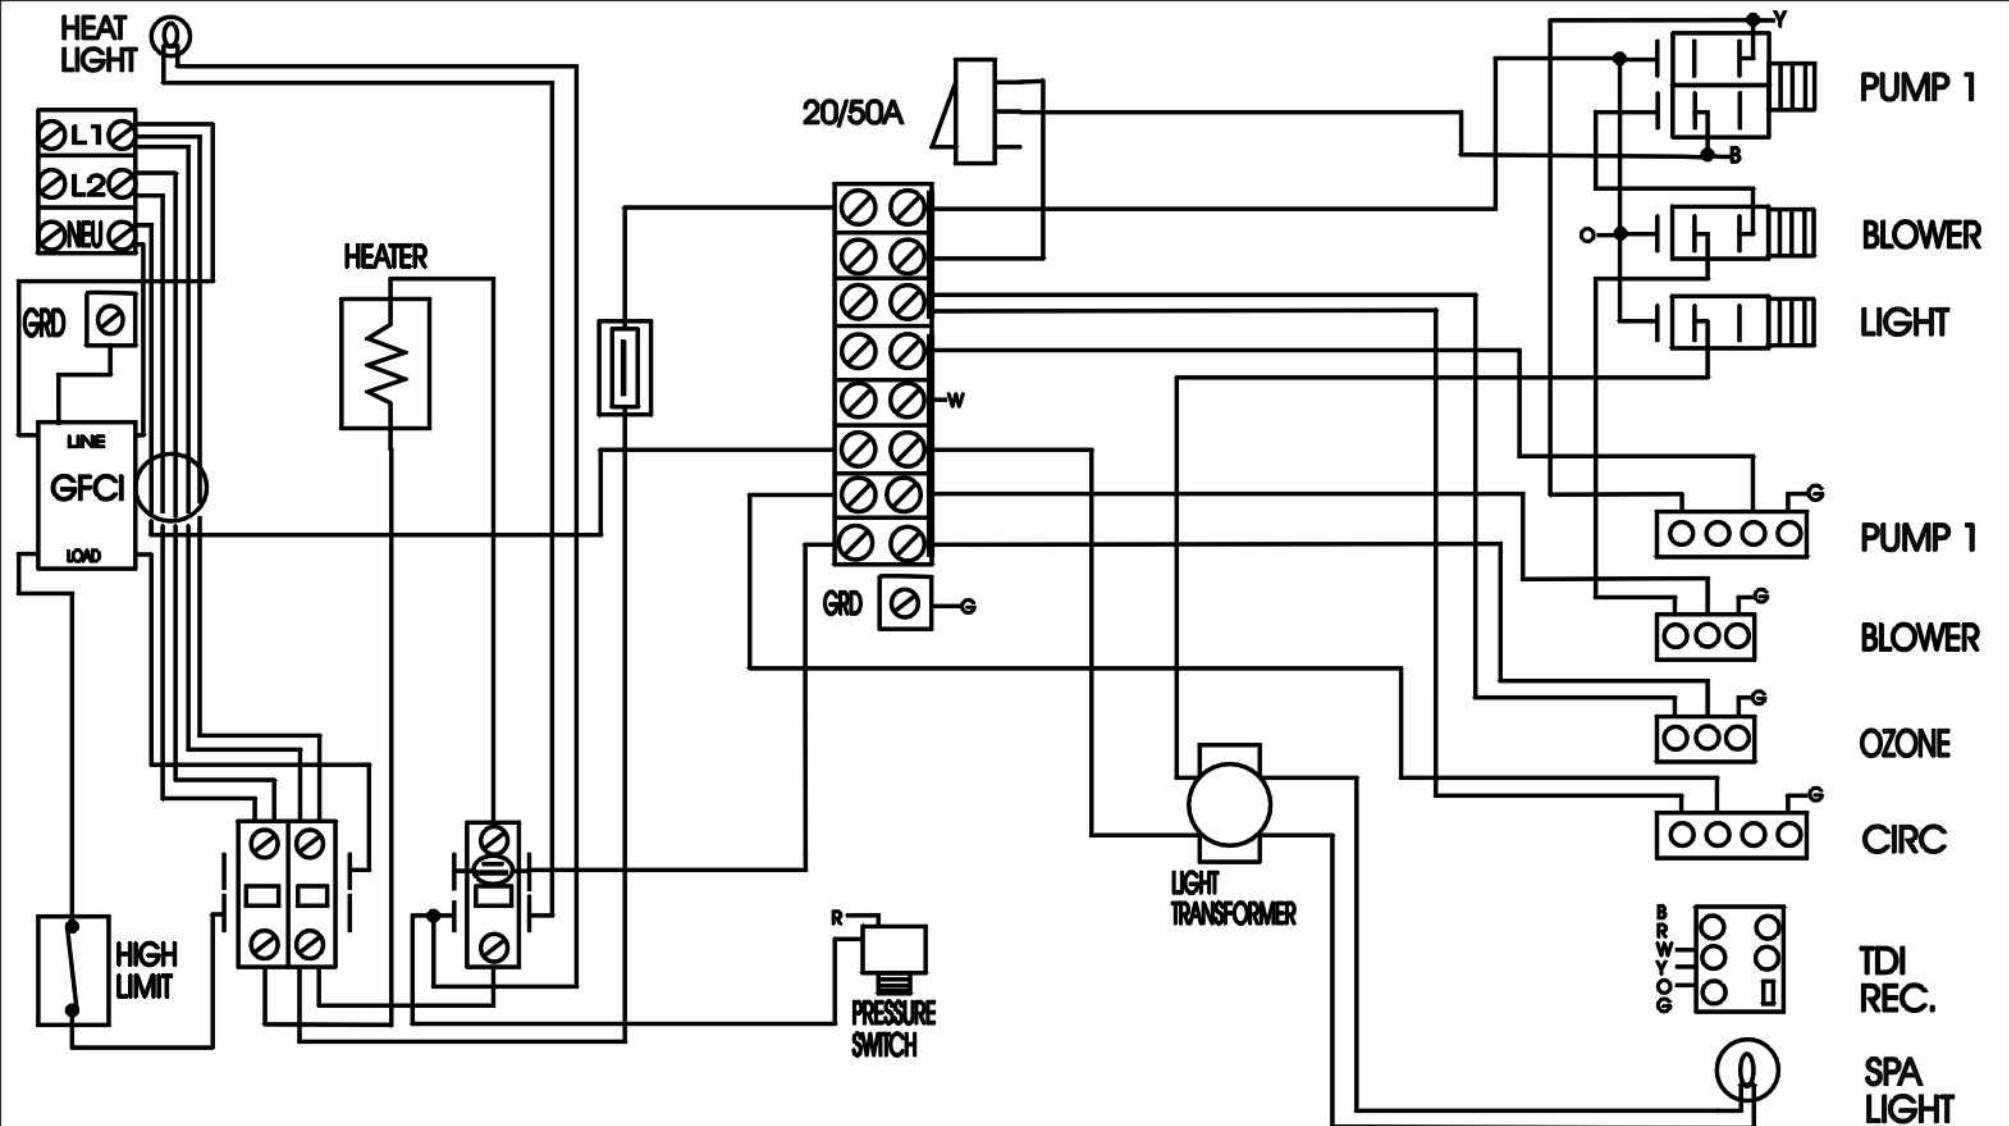

TITLE:
SC: AP-1400 110/220V

PART NUMBER:
3-70-0140

ELECTRICAL REQUIREMENTS

IF THE SYSTEM HAS TWO JET PUMPS, IT WILL RUN APPROXIMATELY 48 AMPS MAXIMUM LOAD. THIS REQUIRES A 60 AMP CIRCUIT BREAKER. IF THE SYSTEM HAS ONLY ONE JET PUMP, IT WILL RUN APPROXIMATELY 40 AMPS MAXIMUM LOAD. THIS REQUIRES A 50 AMP CIRCUIT BREAKER.

NOTES:		REV.	CHANGE RELEASE	DATE	APPROVALS	DATE
PAK #5						
1	SPA SIDE READY (TDI)	A			DRAWN BY:	
2		B			CHECKED BY:	
3		C			APPROVED BY:	

**SPA BUILDERS
SYSTEMS GROUP, Inc.**

1219 S. BON VIEW AVE.
ONTARIO, CA. 91761

PHONE (909) 930-9733
FAX (909) 930-9934