


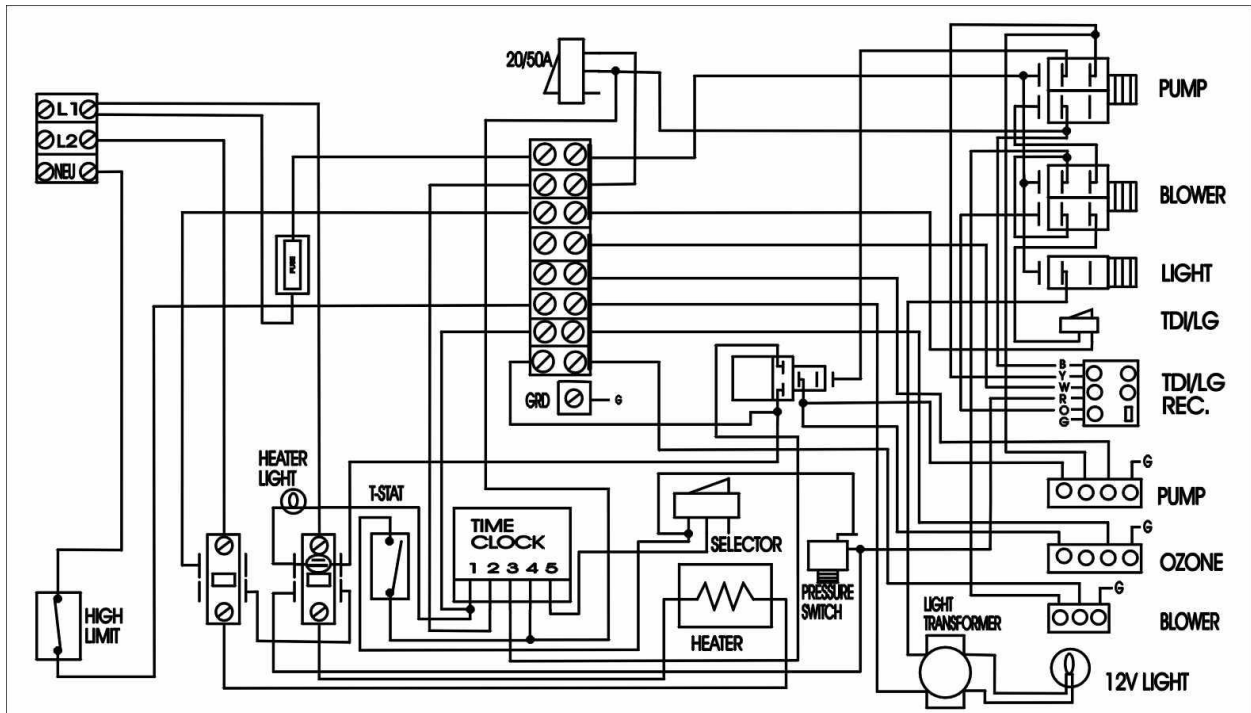

TITLE:
WH: AP-1400 110/220V

PART NUMBER:
3-80-0239

ELECTRICAL REQUIREMENTS

IF THE SYSTEM HAS ONLY ONE JET PUMP: AT 220 VOLTS IT WILL RUN APPROXIMATELY 40 AMPS MAXIMUM LOAD. THIS REQUIRES A 50 AMP SERVICE. AT 110 VOLTS IT WILL RUN APPROXIMATELY 15 AMPS MAXIMUM LOAD. THIS REQUIRES A 20 AMP SERVICE.

NOTES:

1

2

3

REV.

A

B

C

CHANGE RELEASE

INITIAL RELEASE

DATE

3/00

APPROVALS

DRAWN BY:

CHECKED BY:

APPROVED BY:

EDD

DATE

3/00

**SPA BUILDERS
SYSTEMS GROUP, Inc.**

1219 S. BON VIEW AVE.
ONTARIO, CA. 91761

PHONE (909) 930-9733
FAX (909) 930-9934